




**RESTRICTED CONFIDENTIAL DOCUMENT**  
 THIS DRAWING AND ALL INFORMATION SHOWN HEREON ARE THE EXCLUSIVE PROPERTY OF WELLS-GARDNER CORP. AND ARE SUBMITTED ONLY ON A CONFIDENTIAL BASIS. THE RECIPIENT AGREES NOT TO REPRODUCE THE DRAWING, TO RETURN IT UPON REQUEST, AND THAT NO DISCLOSURE OF THE DRAWING, TO RETURN IT UPON REQUEST, AND THAT NO DISCLOSURE OF THE DRAWING OR THE INFORMATION SHOWN HEREON WILL BE MADE TO A THIRD PARTY WITHOUT PRIOR WRITTEN CONSENT FROM WELLS-GARDNER CORPORATION.

- \*\* WARNING \*\***  
 BEFORE SERVICING THIS CHASSIS READ THE "X-RAY RADIATION PRECAUTION", "SAFETY PRECAUTION" AND "PRODUCT SAFETY NOTICE" IN THE SERVICE MANUAL.
- \*\* NOTE \*\***
1. RESISTANCE IS SHOWN IN OHM K-1000 M-1000000
  2. UNLESS OTHERWISE NOTED IN SCHEMATIC ALL CAPACITOR VALUES LESS THAN 1 ARE EXPRESSED IN UF AND THE VALUES MORE THAN 1 IN PF.
  3. VOLTAGES READ WITH "V.T.V.M." FORM POINT INDICATED TO CHASSIS GROUND USING A COLOR BAR SIGNAL WITH ALL CONTROLS NORMAL MAIN VOLTAGE 120 VOLTS AC VOLTAGE READINGS SHOWN ARE NOMINAL VALUES AND MAY VARY + 20% EXCEPT H.V.
  4. IN CASE OF 13" RECEIVER THE COMPONENT WITHIN THE MAKE # A SHOULD BE USED ONLY.
  5. THIS CIRCUIT DIAGRAM IS A STANDARD ONE CIRCUITS PRINTED MAY BE SUBJECT TO CHANGE FOR PRODUCT IMPROVEMENT WITHOUT PRIOR NOTICE. CAUTION SAFETY CRITICAL COMPONENT.
- \* X-RAY PROTECTION RELATED COMPONENT REPLACE ONLY WITH SAME TYPE PARTS AS SHOWN IN PARTS LIST.

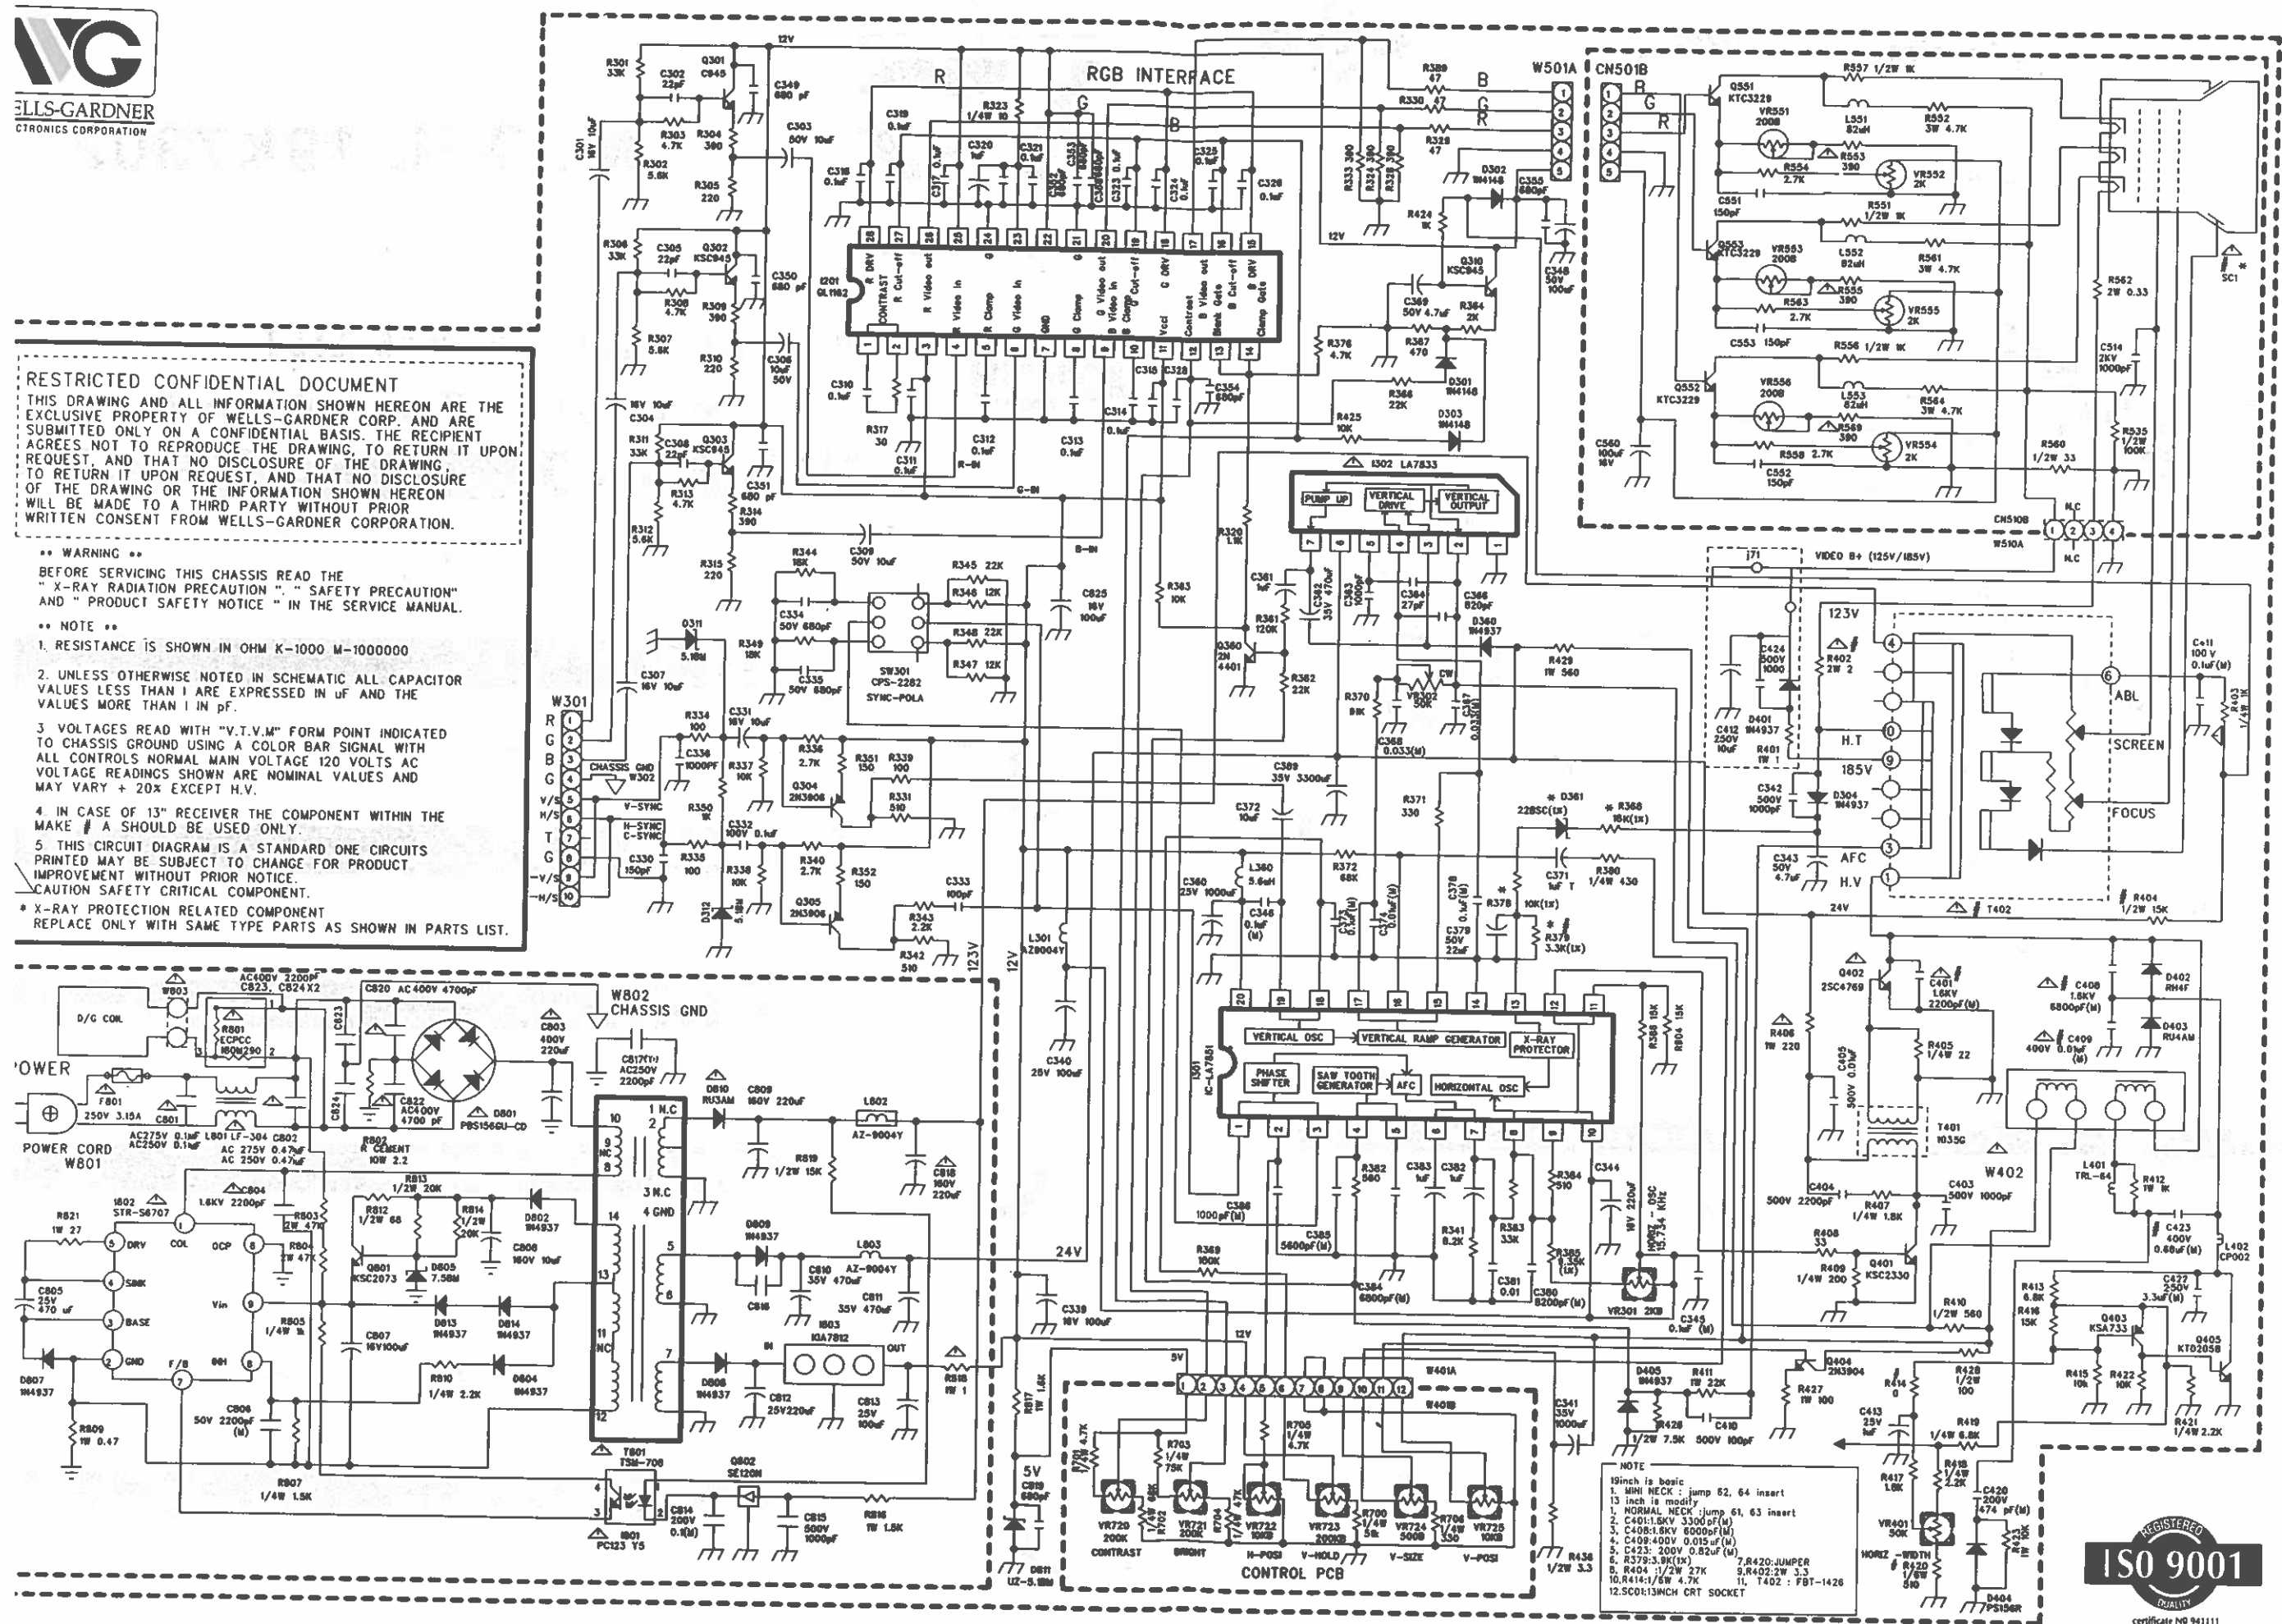

**NOTE**  
 10inch is basic  
 13 inch is modify  
 1. NORMAL NECK: jump 61, 63 insert  
 2. C401: 1.8KV 3300pf(M)  
 3. C408: 8KV 8000pf(M)  
 4. C409: 400V 0.015 uf(M)  
 5. C423: 200V 0.02uf(M)  
 6. R379: 3.9K(1x)  
 7. R420: JUMPER  
 8. R404: 1/2W 27K  
 9. R402: 2W 3.3  
 10. R414: 1/4W 4.7K  
 11. T402: FBT-1426  
 12. SC01: 13INC CRT SOCKET

